
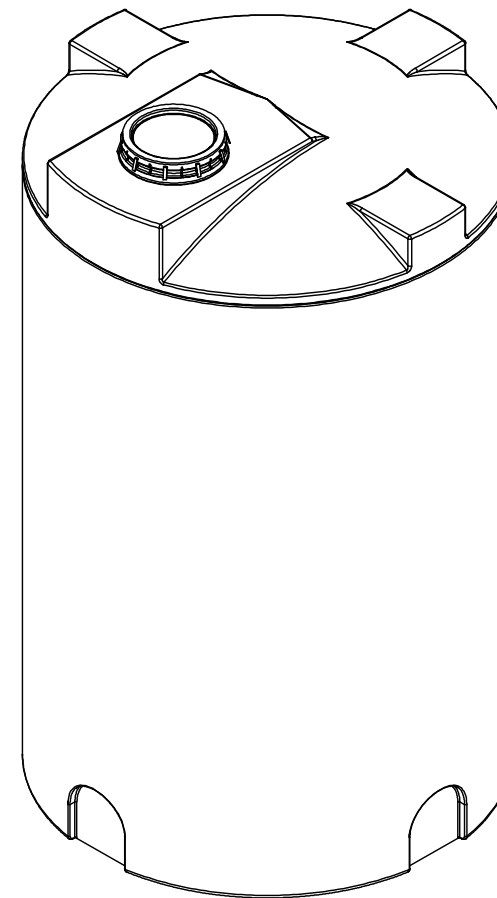
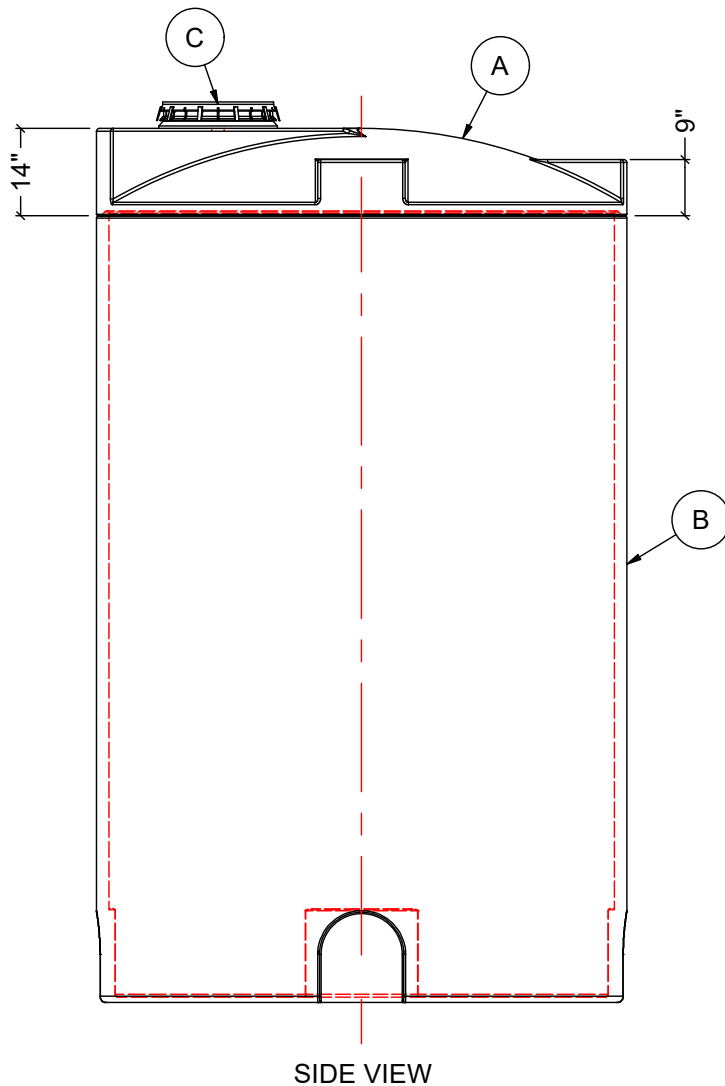


- NOTES:
1. TANK IS MANUFACTURED FROM POLYETHYLENE (PE) OR CROSSLINK PE (XLPE).
 2. RATING FOR STORING LIQUIDS WITH A SPECIFIC GRAVITY (DENSITY) OF 1.5SG. (1.9SG AND 2.2SG ALSO AVAILABLE)
 3. ALL TANK DIMENSIONS ARE SUBJECT TO A +/-3% TOLERANCE.
 4. ALL EXTERNAL PIPING AND ACCESSORIES MUST BE FULLY SUPPORTED AND FLEXIBLE TO AVOID STRESSING THE TANK.
 5. FITTING GASKETS AVAILABLE IN EPDM OR VITON.
 6. TANK MUST BE PROPERLY VENTED TO PREVENT PRESSURE OR VACUUM FROM DEVELOPING AS THE TANK IS FILLING OR EMPTYING.
 7. STANDARD LID IS 16" NON-VENTED. LID ALSO AVAILABLE IN 21" VENTED OR NON-VENTED.
 8. TANK IS MANUFACTURED TO ASTM-D-1998 STANDARD
 9. BOTTOM OUTLET FITTING MAY ONLY BE INSTALLED ON A FITTING FLAT LOCATED AT 0°, 90°, 180° OR 270°.
 10. CONTAINMENT TANK IS 1.5SG PE AS STANDARD.


MATERIALS LIST		
ITEMS	DESCRIPTION	NOTES
A	DMT-2205 PRIMARY TANK	
B	DMT-2205 CONTAINMENT TANK	
C	16" LID WITH LOCKING STRAP	

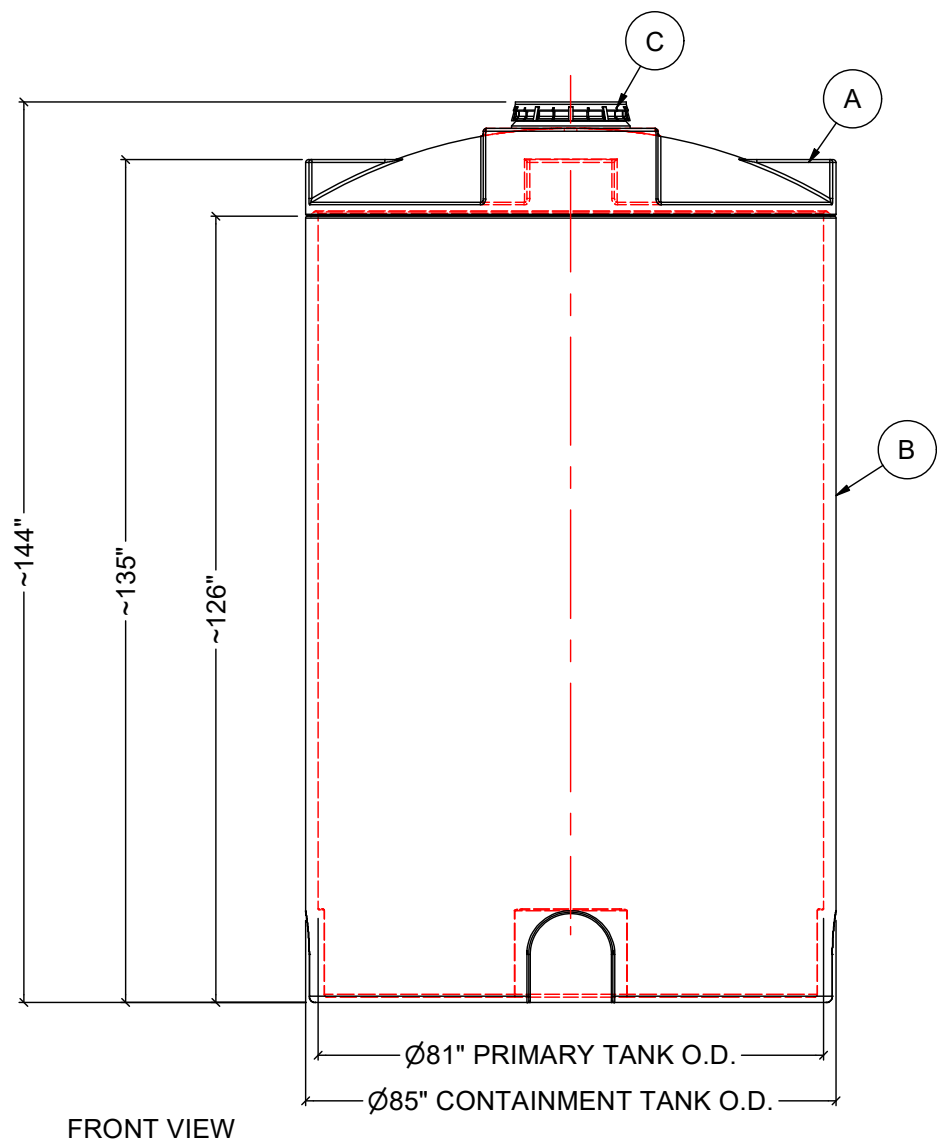

REV	DATE	DESCRIPTION	BY	APPD	REVD
1	NOV-11-21	MODIFIED LID PLACEMENT	WM		

REVISIONS	
CUSTOMER	
TITLE	ACO JOB NO:
2200 IG / 2640 USG / 10,000 L	PO#:
DOUBLE WALL TANK	EQUIP. NO:

THIS DRAWING IS THE PROPERTY OF ROTOPLAST INC. AND SHALL NOT BE COPIED OR TRANSFERRED WITHOUT THE WRITTEN CONSENT OF ROTOPLAST INC.



ACO CONTAINER SYSTEMS
DIVISION OF ROTOPLAST INC.
794 MCKAY ROAD
PICKERING, ONTARIO, CANADA
TEL: 905-683-8222
WEB: ACOTAINERS.COM

DESIGNED	WM
DRAWN	
CHECKED	
APPROVED	
SCALE	N.T.S.
DATE	JAN-07-2021

DWG No: DMT-2205 REV 1